

# ATN Series

## DIN W48×H48mm, Universal Voltage Multi-Function Timer

### ■ Features

- Realization of wide range of power supply  
:100-240VAC 50/60Hz / 24-240VDC universal,  
24VAC 50/60Hz / 24VDC universal, 12VDC
- Various output operation (6 kinds modes)
- Multi time range (16 kinds of time range)
- Wide control time (0.05sec. to 100hour)
- Easy setting of time, time range, output operation mode
- Easy to check output status by LED display



**⚠ Please read "Caution for your safety" in operation manual before using.**



### ■ Ordering Information

<b>AT</b>	<b>8</b>	<b>N</b>	—		
Item	Number of plug pins	Time operation	Power supply	No mark	100-240VAC 50/60Hz / 24-240VDC
				1	12VDC
				2	24VAC 50/60Hz / 24VDC
				N	Time limit contact 2c or time limit contact 1c with instantaneous contact 1c by selecting output operation mode
	8			8-pin plug type	
	AT			Analog Timer	

※Sockets (PG-08, PS-08(N)) are sold separately.

<b>AT</b>	<b>11</b>	<b>DN</b>	—		
Item	Number of plug pins	Time operation	Power supply	No mark	100-240VAC 50/60Hz / 24-240VDC
				1	12VDC
				2	24VAC 50/60Hz / 24VDC
				DN	Time limit 2c
	11			11-pin plug type	
	AT			Analog Timer	

※Sockets (PG-11, PS-11(N)) are sold separately.

### ■ Specifications

Model	AT8N-□	AT11EN-□	AT11DN-□	
Function	Multi function timer			
Control time setting range	0.05 sec. to 100 hour			
Power supply	• 100-240VAC 50/60Hz, 24-240VDC universal • 24VAC 50/60Hz, 24VDC universal • 12VDC			
Allowable voltage range	90 to 110% of rated voltage			
Power consumption	• Max. 4.3VA (100-240VAC), Max. 2W (24-240VDC) • Max. 4.5VA (24VAC), Max. 2W (24VDC) • Max. 1.5W (12VDC)	• Max. 3.5VA (100-240VAC), Max. 1.5W (24-240VDC) • Max. 4VA (24VAC), Max. 1.5 (24VDC) • Max. 1W (12VDC)		
Reset time	Max. 100ms			
Min. input signal width	START	—	Min. 50ms	
	INHIBIT			
	RESET			
Input	START	—	No-voltage input - Short-circuit impedance: Max. 1kΩ Residual voltage: Max. 0.5V Open-circuit impedance: Min. 100kΩ	
	INHIBIT			
	RESET			
Timing operation	Power ON start type	Signal ON Start type		
Control output	Contact type	Time limit DPDT (2c), Time limit DPDT (1c)+ Instantaneous DPDT (1c) by selecting output operation mode	Time limit SPDT (1c), Instantaneous SPDT (1c)	Time limit DPDT (2c)
	Contact capacity	250VAC 5A resistive load		
Relay life cycle	Mechanical	Min. 10,000,000 operations		
	Electrical	Min. 100,000 operations (250VAC 5A resistive load)		
Repeat error	Max. ±0.2% ±10ms			
SET error	Max. ±5% ±50ms			
Voltage error	Max. ±0.5%			
Temperature error	Max. ±2%			
Insulation resistance	Min. 100MΩ (at 500VDC megger)			
Dielectric strength	2000VAC 50/60Hz for 1 minute			
Environment	Ambient temperature	-10 to 55°C, storage: -25 to 65°C		
	Ambient humidity	35 to 85%RH		
Approval	CE c UL US			
Accessory	Bracket			
Unit weight	Approx. 90g			


※Environment resistance is rated at no freezing or condensation.

# Multi Function Timer

## ■ Connections


### ○ AT8N

#### ● [A], [F] mode

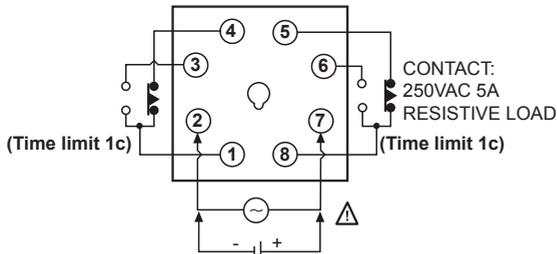


SOURCE:  
 • 100-240VAC 50/60Hz, 24-240VDC  
 • 24VAC 50/60Hz, 24VDC  
 • 12VDC

#### ● [A1], [B], [F1], [I] mode

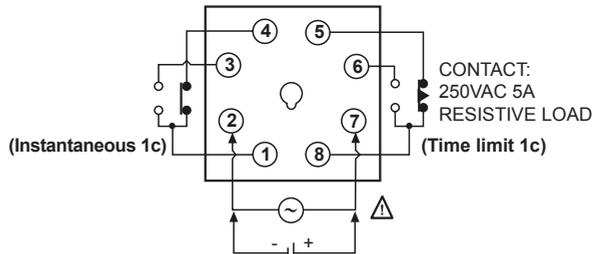


SOURCE:  
 • 100-240VAC 50/60Hz, 24-240VDC  
 • 24VAC 50/60Hz, 24VDC  
 • 12VDC

### ○ AT11DN

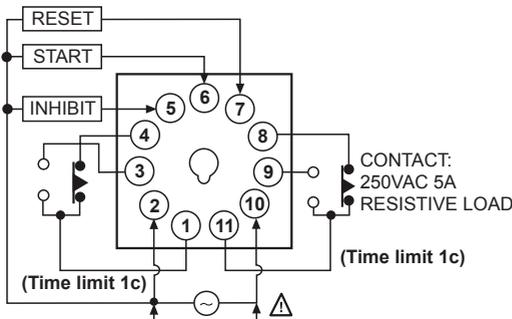

SOURCE:  
 • 100-240VAC 50/60Hz, 24-240VDC  
 • 24VAC 50/60Hz, 24VDC  
 • 12VDC

### ○ AT11DEN


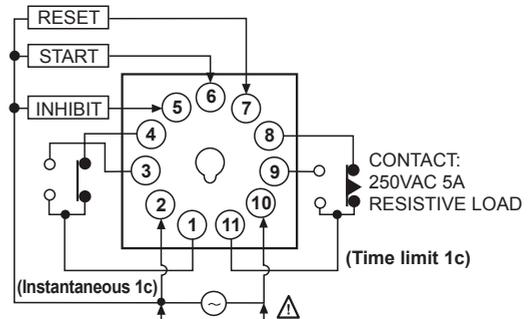


SOURCE:  
 • 100-240VAC 50/60Hz, 24-240VDC  
 • 24VAC 50/60Hz, 24VDC  
 • 12VDC



## ■ Dimensions

(unit: mm)

### ● Bracket

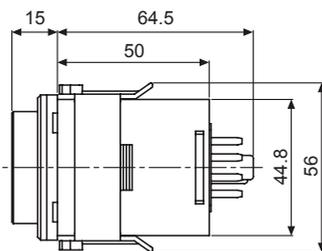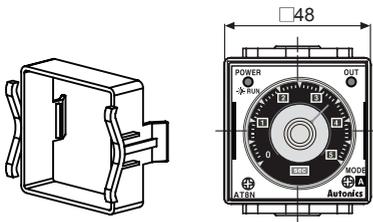

### ● Panel cut-out

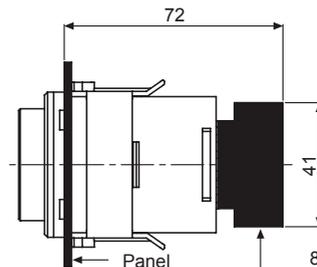


8-pin socket: PG-08 (sold separately)  
 11-pin socket: PG-11 (sold separately)  
 ※Refer to page G-19.

(A) Photoelectric Sensors
(B) Fiber Optic Sensors
(C) Door/Area Sensors
(D) Proximity Sensors
(E) Pressure Sensors
(F) Rotary Encoders
(G) Connectors/ Sockets
(H) Temperature Controllers
(I) SSRs / Power Controllers
(J) Counters
(K) Timers
(L) Panel Meters
(M) Tacho / Speed / Pulse Meters
(N) Display Units
(O) Sensor Controllers
(P) Switching Mode Power Supplies
(Q) Stepper Motors & Drivers & Controllers
(R) Graphic/ Logic Panels
(S) Field Network Devices
(T) Software

# ATN Series

## ■ Unit Description

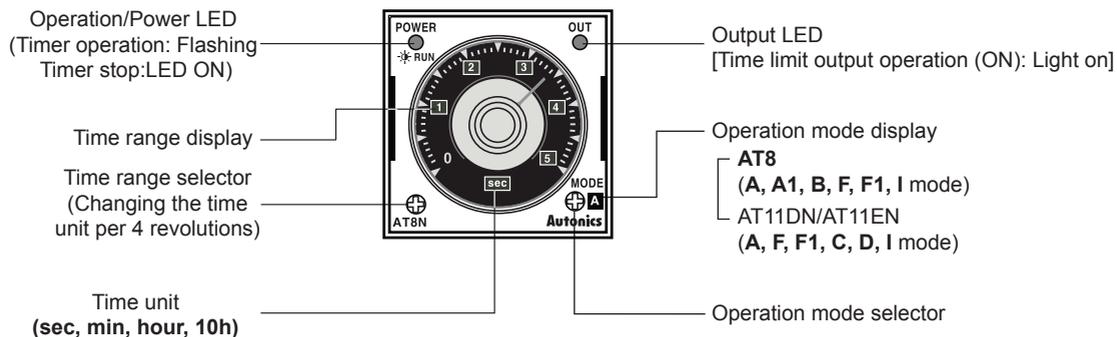

※Please rotate the time range switch and operation mode switch to CW (Clockwise) direction.

## ■ Time Specifications

Time range	Time unit	Time setting range
0.5	<b>sec</b>	0.05 to 0.5 sec.
1.0		0.1 to 1.0 sec.
5		0.5 to 5 sec.
10		1 to 10 sec.
0.5	<b>min</b>	0.05 to 0.5 min.
1.0		0.1 to 1.0 min.
5		0.5 to 5 min.
10		1 to 10 min.
0.5	<b>hour</b>	0.05 to 0.5 hour
1.0		0.1 to 1.0 hour
5		0.5 to 5 hour
10		1 to 10 hour
0.5	<b>10h</b>	0.5 to 5 hour
1.0		1 to 10 hour
5		5 to 50 hour
10		10 to 100 hour

## ■ Output Operation Mode Of Each Model

### ● AT8N

Display	Output operation mode
<b>A</b>	Power ON Delay
<b>A1</b>	Power ON Delay 1
<b>B</b>	Power ON Delay 2
<b>F</b>	Flicker (OFF Start)
<b>F1</b>	Flicker 1 (ON Start)
<b>I</b>	Interval

### ● AT11DN/AT11EN

Display	Output operation mode
<b>A</b>	Signal ON Delay
<b>F</b>	Flicker (OFF Start)
<b>F1</b>	Flicker 1 (ON Start)
<b>C</b>	Signal OFF Delay
<b>D</b>	Signal ON/OFF Delay
<b>I</b>	Interval

# Multi Function Timer

## ■ AT8N Output Operation Mode

[t:Setting time,  $t > t-a$ , Rt:Return time,  $Rt1 > Rt$ ]


Mode	Time chart
<b>A</b>	
<b>Power ON Delay</b>	
<b>A1</b>	<p>※One-shot output is 0.5sec fixed.</p>
<b>Power ON Delay 1 (One-shot output)</b>	
<b>B</b>	
<b>Power ON Delay 2</b>	
<b>F</b>	
<b>Flicker (OFF Start)</b>	
<b>F1</b>	
<b>Flicker 1 (ON Start)</b>	
<b>I</b>	
<b>Interval</b>	

※When using F, F1 output operation modes, if the time is set too short, the output may not work properly. Please set the time at least over 100ms.

- (A) Photoelectric Sensors
- (B) Fiber Optic Sensors
- (C) Door/Area Sensors
- (D) Proximity Sensors
- (E) Pressure Sensors
- (F) Rotary Encoders
- (G) Connectors/Sockets
- (H) Temperature Controllers
- (I) SSRs / Power Controllers
- (J) Counters
- (K) Timers
- (L) Panel Meters
- (M) Tacho / Speed / Pulse Meters
- (N) Display Units
- (O) Sensor Controllers
- (P) Switching Mode Power Supplies
- (Q) Stepper Motors & Drivers & Controllers
- (R) Graphic/Logic Panels
- (S) Field Network Devices
- (T) Software

## ■ AT11DN/AT11EN Output Operation Mode

[t:Setting time,  $t=t_1+t_2$ ,  $t>t-a$ ]

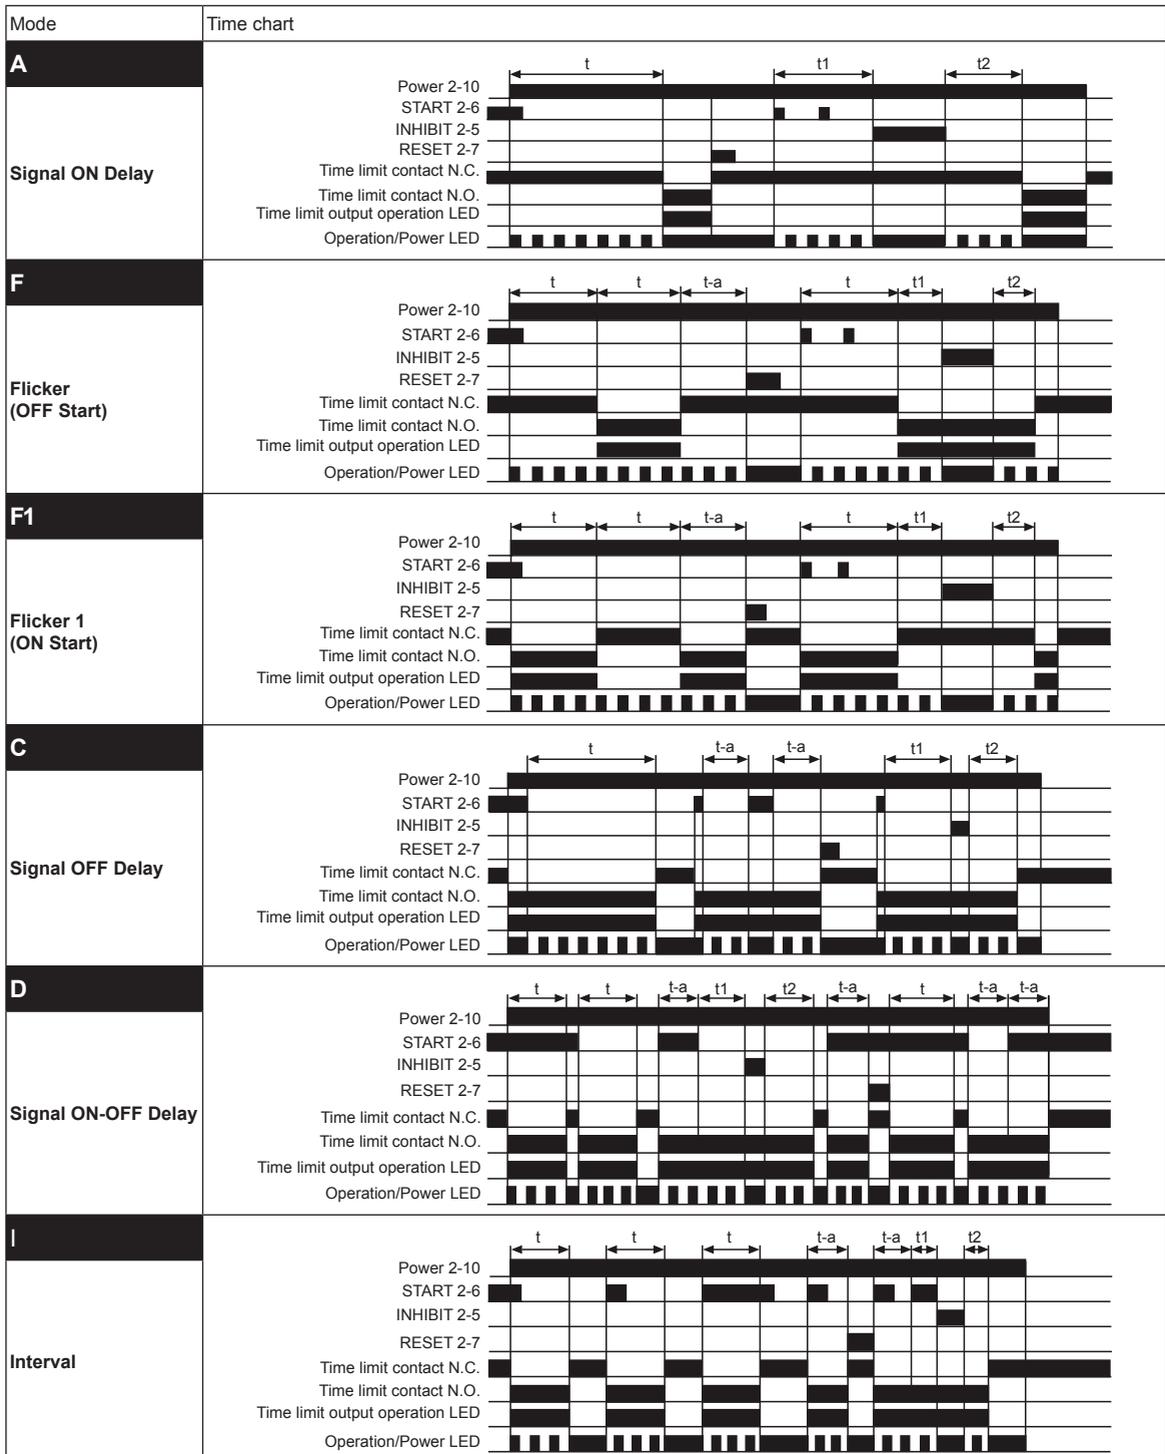


- ※1: If power is removed or the RESET terminal is short-circuited, the timer will be reset.
- 2: If the INHIBIT terminal is short-circuited during a timing cycle, the time will stop.
- 3: When using F, F1 output operation modes, if the time is set too short, the output may not work properly. Please set the time at least over 100ms.

## ■ Proper Usage


### ◎ Repeat function (Flicker)

- It enables to use one ATN timer for 3 sub relays and 2 timers (Flicker function).  
Simple to use flicker function with only one ATN timer.
- Switch A: Start, Switch B: Reset.

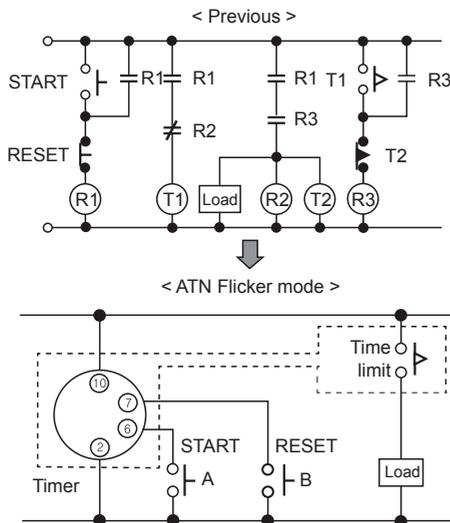

### ◎ Interval mode

It enables to make instantaneous ON and time limit OFF (remained circuit) with using Interval mode.

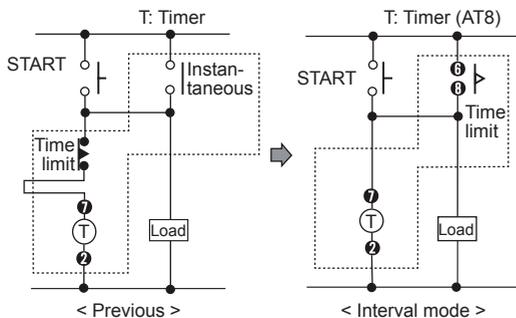


### ◎ Input signal condition (AT11DN, AT11EN)

#### 1. Relay contact input

Please use gold-plated switches with good contact assurance and short bouncing time for contact input.  
(Open resistance: Over 100kΩ, Short-circuit resistance: Under 1kΩ)  
※Please use a contact that can function reliably at 5VDC 0.4mA.

#### 2. Input with NPN open collector type


Characteristics of transistor should be  $V_{ce0} = \text{min. } 25\text{V}$ ,  $I_c = \text{min. } 10\text{mA}$ ,  $I_{cbo} = \text{max. } 0.2\mu\text{A}$ , residual voltage = max. 0.5V.

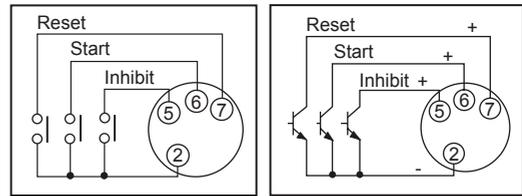

#### 3. NPN universal input

It enables to use voltage output type as input signal source instead of open collector output in solid-state circuit (proximity sensor, photo-electric sensor) which has range of 10-30VDC output voltage.

When H signal changes to L, timer will start.  
When transistor (Q) is ON status, please make residual voltage under 0.5V.

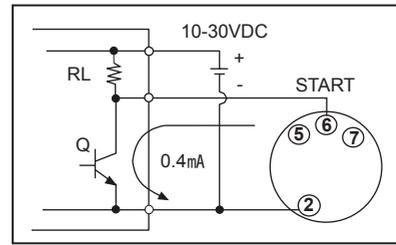

### ◎ Terminal connection

- Please wire correctly with wiring instructions
- Power connection

Connect the power line without observing polarity for ATN series AC power type, but please be careful of power connection for DC power type.

Power supply	8-pin Type	11-pin Type
AC Type	Terminal ② - ⑦	Terminal ② - ⑩
DC Type	Terminal ② ← ⊖	Terminal ② ← ⊖
	Terminal ⑦ ← ⊕	Terminal ⑩ ← ⊕

- When turning off the power, be careful of inductive voltage.  
(If using power line with another high voltage line or energy line near by, it may cause inductive voltage).
- Power ripple should be under 10% and power supply should be within range of allowable voltage for DC power type.
- Please supply the power quickly when using a switch or a relay contact. Otherwise, it may cause time error or power reset failure.
- The load of Control output should be under rated load capacity.

(A)	Photoelectric Sensors
(B)	Fiber Optic Sensors
(C)	Door/Area Sensors
(D)	Proximity Sensors
(E)	Pressure Sensors
(F)	Rotary Encoders
(G)	Connectors/ Sockets
(H)	Temperature Controllers
(I)	SSRs / Power Controllers
(J)	Counters
(K)	Timers
(L)	Panel Meters
(M)	Tacho / Speed / Pulse Meters
(N)	Display Units
(O)	Sensor Controllers
(P)	Switching Mode Power Supplies
(Q)	Stepper Motors & Drivers & Controllers
(R)	Graphic/ Logic Panels
(S)	Field Network Devices
(T)	Software


# ATN Series

## Setting time, time range, operation mode


Do not change time range or operation mode while time operating. When changing it, please power off or apply reset signal.

## Input connection


- AT11DN/AT11EN Timer is non-transformer type, therefore please check following for connecting relay contact for input signal and transistor.

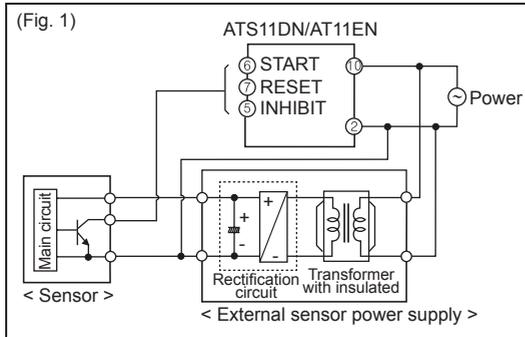

- When using the terminal ① as a common terminal of input signal as (Fig. 2), it may cause damage to the inner circuit of AT11DN/AT11EN, please use the terminal ② for common terminal as (Fig. 3).

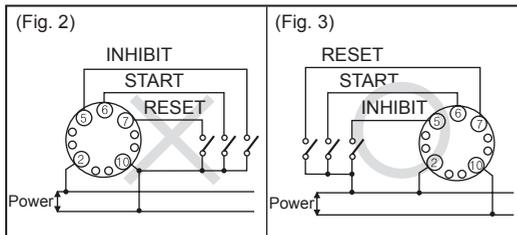


- When using more than one timer with one contact or transistor input, the short current is flowed when it is connected as (Fig. 4). Please connect the power phase as (Fig. 5) correctly.

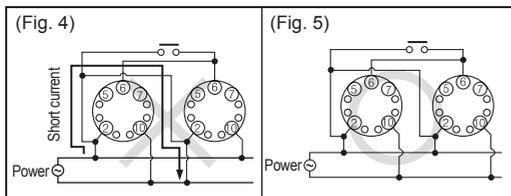

- INHIBIT, START, RESET signal applied by short input terminal ②-⑤, ②-⑥ or ②-⑦. It may cause internal circuit damaged by wrong connection.
- If using power line with another high voltage line or energy line at the same conduit, it may cause inductive voltage. Therefore please use separated conduit for power line.
- When input (INHIBIT, START, RESET) wire is long, please use shield wire and it should be short.

## Common

- For DC power supply type, be sure to check the polarity of terminals.
- In case of 12VDC, 24VAC/DC model, isolated and limited voltage/current or Class 2 source should be provided for power supply.
- When supply the power to the timer, connection shown in (Fig. 6) might cause malfunction due to leakage current through R and C. Please connect R and C as shown in (Fig. 7) to prevent malfunction.

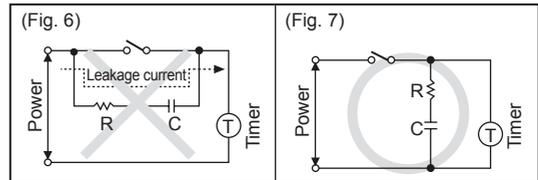

- It might cause malfunction if changing the setting time, time range or operation mode during operating unit. Please change the the setting time, time range or operation mode after cut the power off.
- Do not use this unit at below places.
  - Place where there is severe vibration or impact.
  - Place where strong alkalis or acids is used.
  - Place where there is direct ray of the sun
  - Place where strong magnetic field or electric noise is generated.
- This unit may be used in the following environments.
  - Indoor
  - Altitude: Under 2,000m
  - Pollution degree 2
  - Installation category II